

NOTES

Client to ensure that NINE guidelines for separation of utility services are respected throughout this site.




All cables to be installed in accordance with the cable cross section details on this drawing. Use of incorrect ducts or installation at incorrect depths or failure to install marker tape correctly will result in re-work at the client's cost.

Finished levels and kerb lines must be established before the installation of cables.

Civil Works


All site civil works, including any cable containment, to be undertaken by the client in accordance with the design supplied by Power On.

Power On will undertake all off-site excavation and reinstatement including closing joint holes at the point of connection.

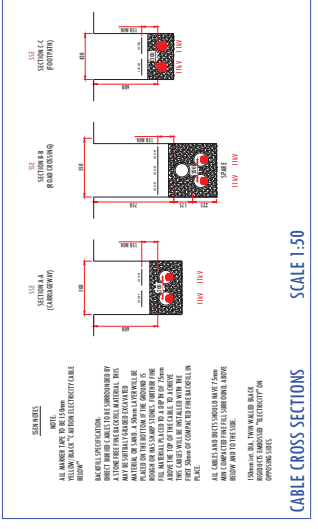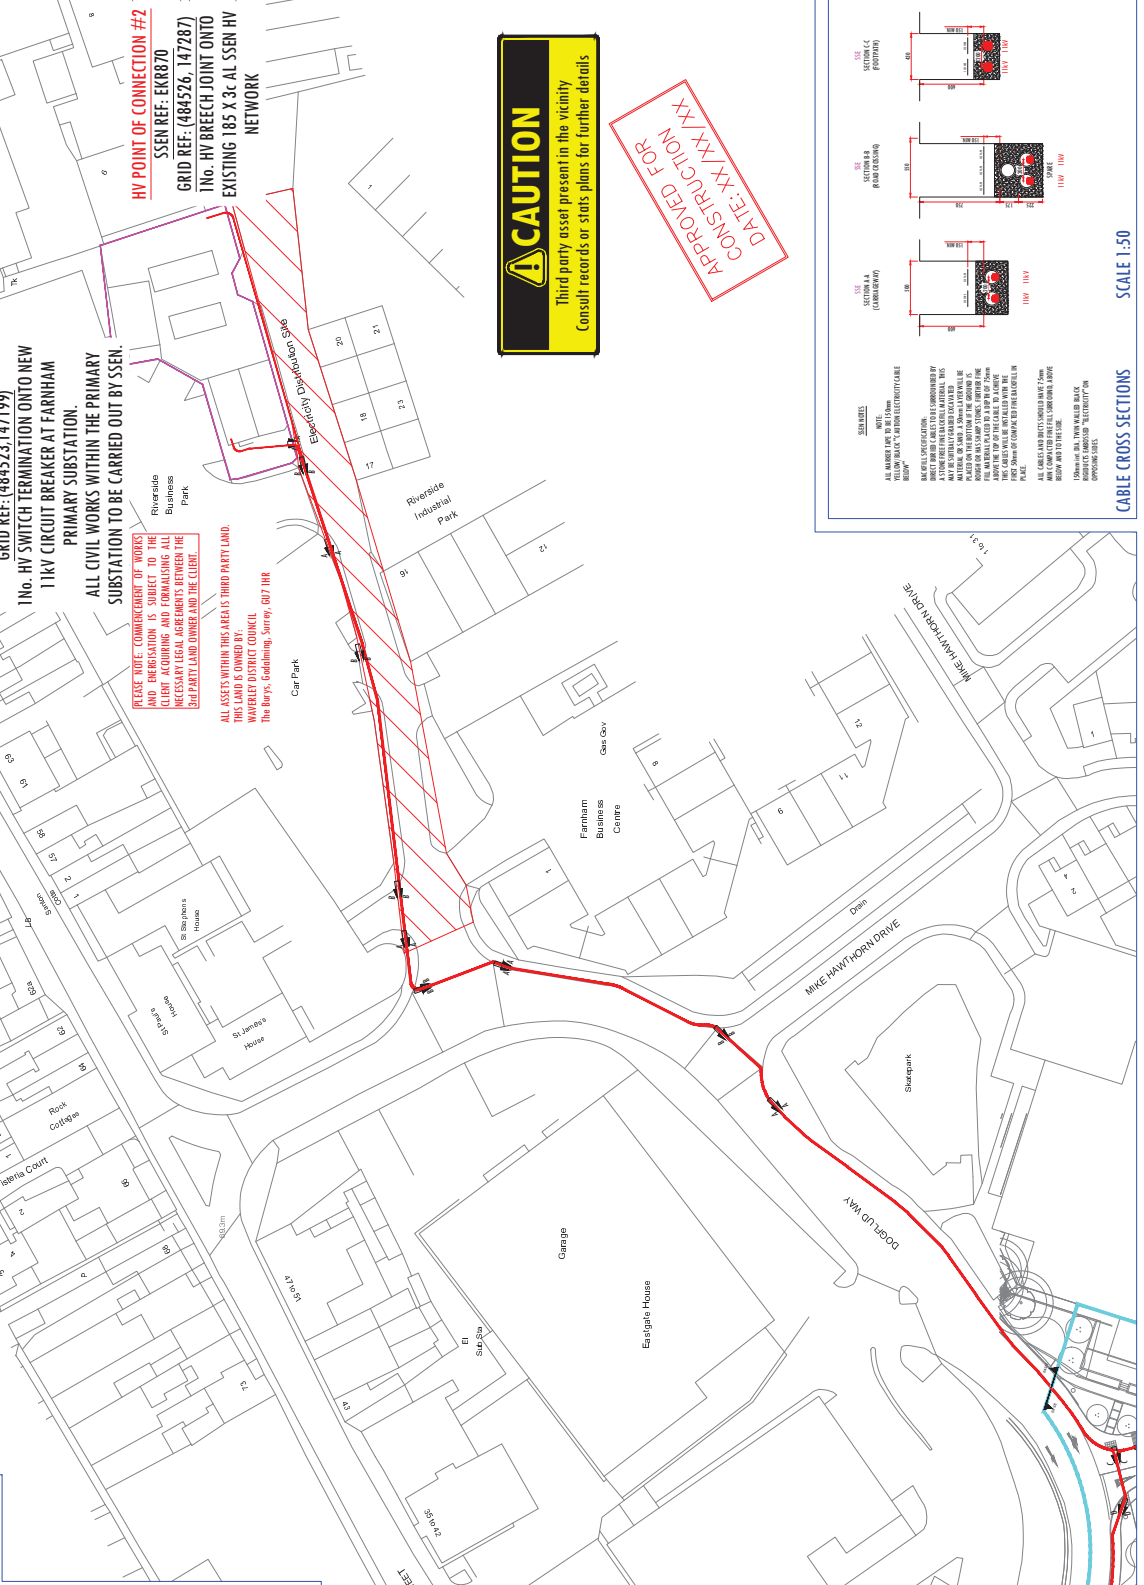

LEGEND

- HV Cable (& Existing HV)
- LV Cable (& Existing LV)
- Live LV Cable
- Control / Signal Cable
- Earth Bonding
- Termination
- Joint (HV / LV / Live LV)
- Pressure End (HV / LV / Live LV)
- Earth Rod
- Legal boundaries
- Building Outline



REV	Amendment	Date	Drawn	Checked
1	PROVISIONAL SUPPLY ORDER BY CLIENT DUE TO UPDATES TO CABLE ROUTE AND PROVISIONAL SUPPLY ORDER. ADDITIONAL LEGAL AGREEMENTS NOT YET SIGNED.	20/04/19	AMR	AM
2	ORIGINAL ISSUE	14/07/18	AMR	AM

POWER ON connections

POWER ON CONNECTIONS Ltd.
 1000 THE CENTRE, WESTERSHAM INDUSTRIAL, WESTERSHAM, WIMBORLEY DISTRICT, HANTS, RG9 3JH
 TELEPHONE: 01493 232322
 FACSIMILE: 01493 274796

Client: CREST NICHOLSON REGENERATION

Project Name: EAST STREET, FARNHAM

Drawing No: SUBSTATION LOCATION & CABLE ROUTE PLAN - OFF-SITE

Site Address: EAST STREET, FARNHAM, SURREY, GU14 7PX

IF IN DOUBT - ASK

Design Engineer: MICHAEL BOULDER 07733 573 325

Client's Site Engineer / Project Manager: NICKIE 07924 439 493

Scale: VARIOUS (High Site: A1) Sheet: 2/4

Network Operator Ref: EK8870 (Contact to verify No. P-0095679/DWG/010)